


### SCC Air Quality Monitoring of Nitrogen Dioxide in Sheffield City Centre Adjusted Annual Averages



Correction factors: 2004 - 1.1; 2005 - 1.11; 2006 - 1.04; 2007 - 1.03; 2008 - 0.93; 2009 - 1.02; 2010 - 1.00, 2011-0.99, 2012-0.91, 2013-1.02, 2014-0.94, 2015-0.99, 2016-0.95, 2017-0.98

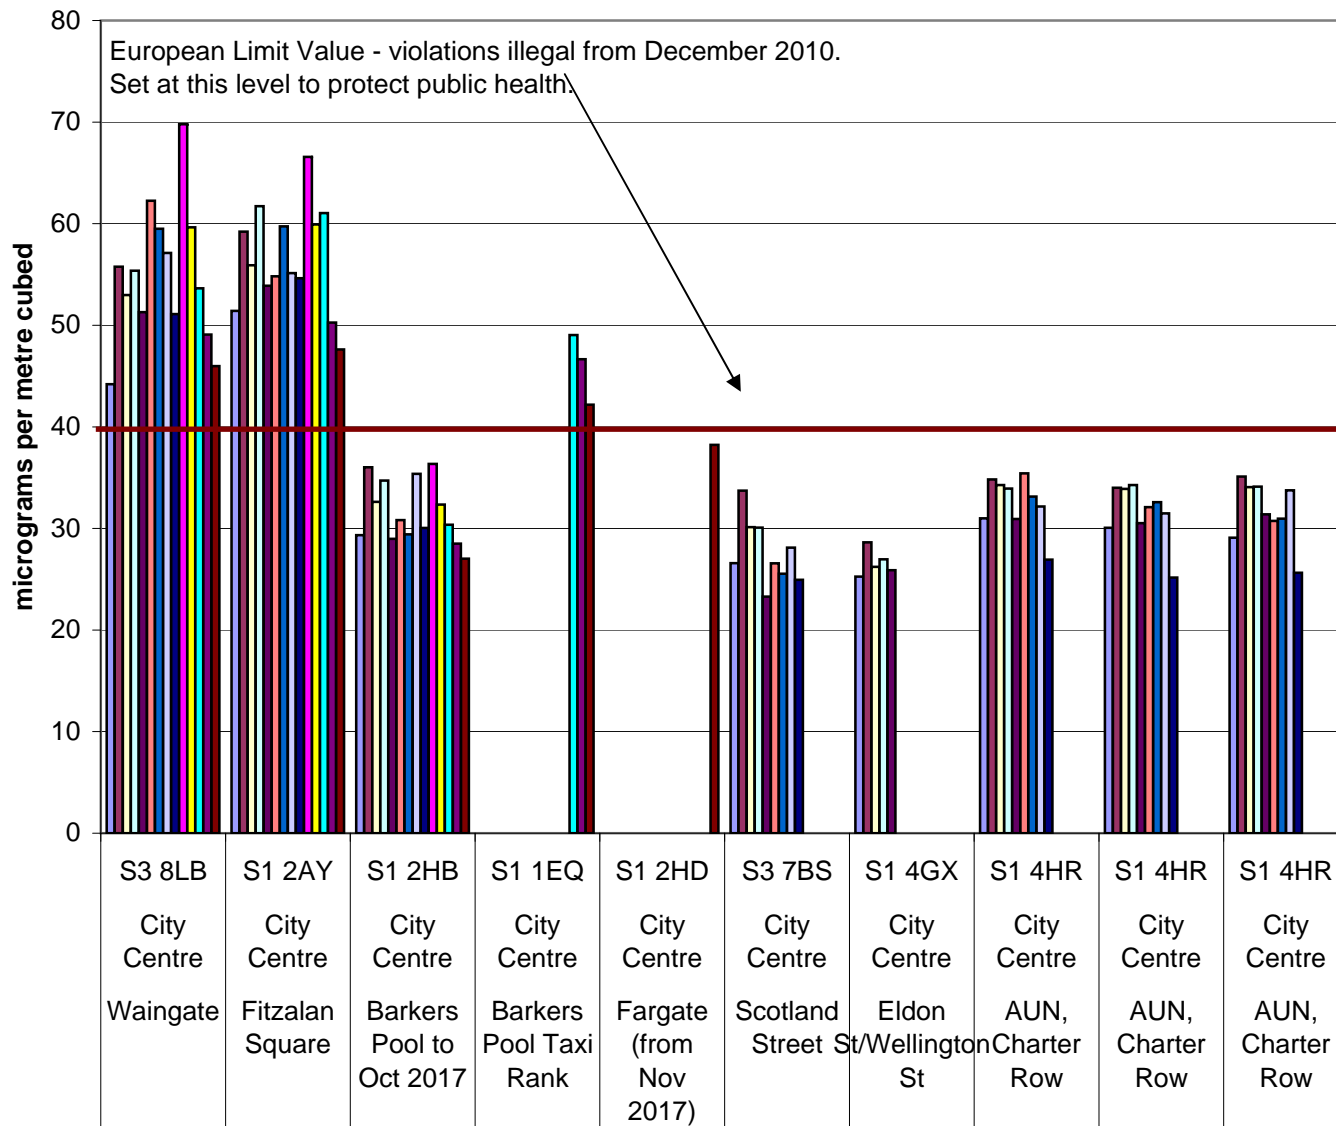